




CENTURION

DC converter wallbox wiring diagram

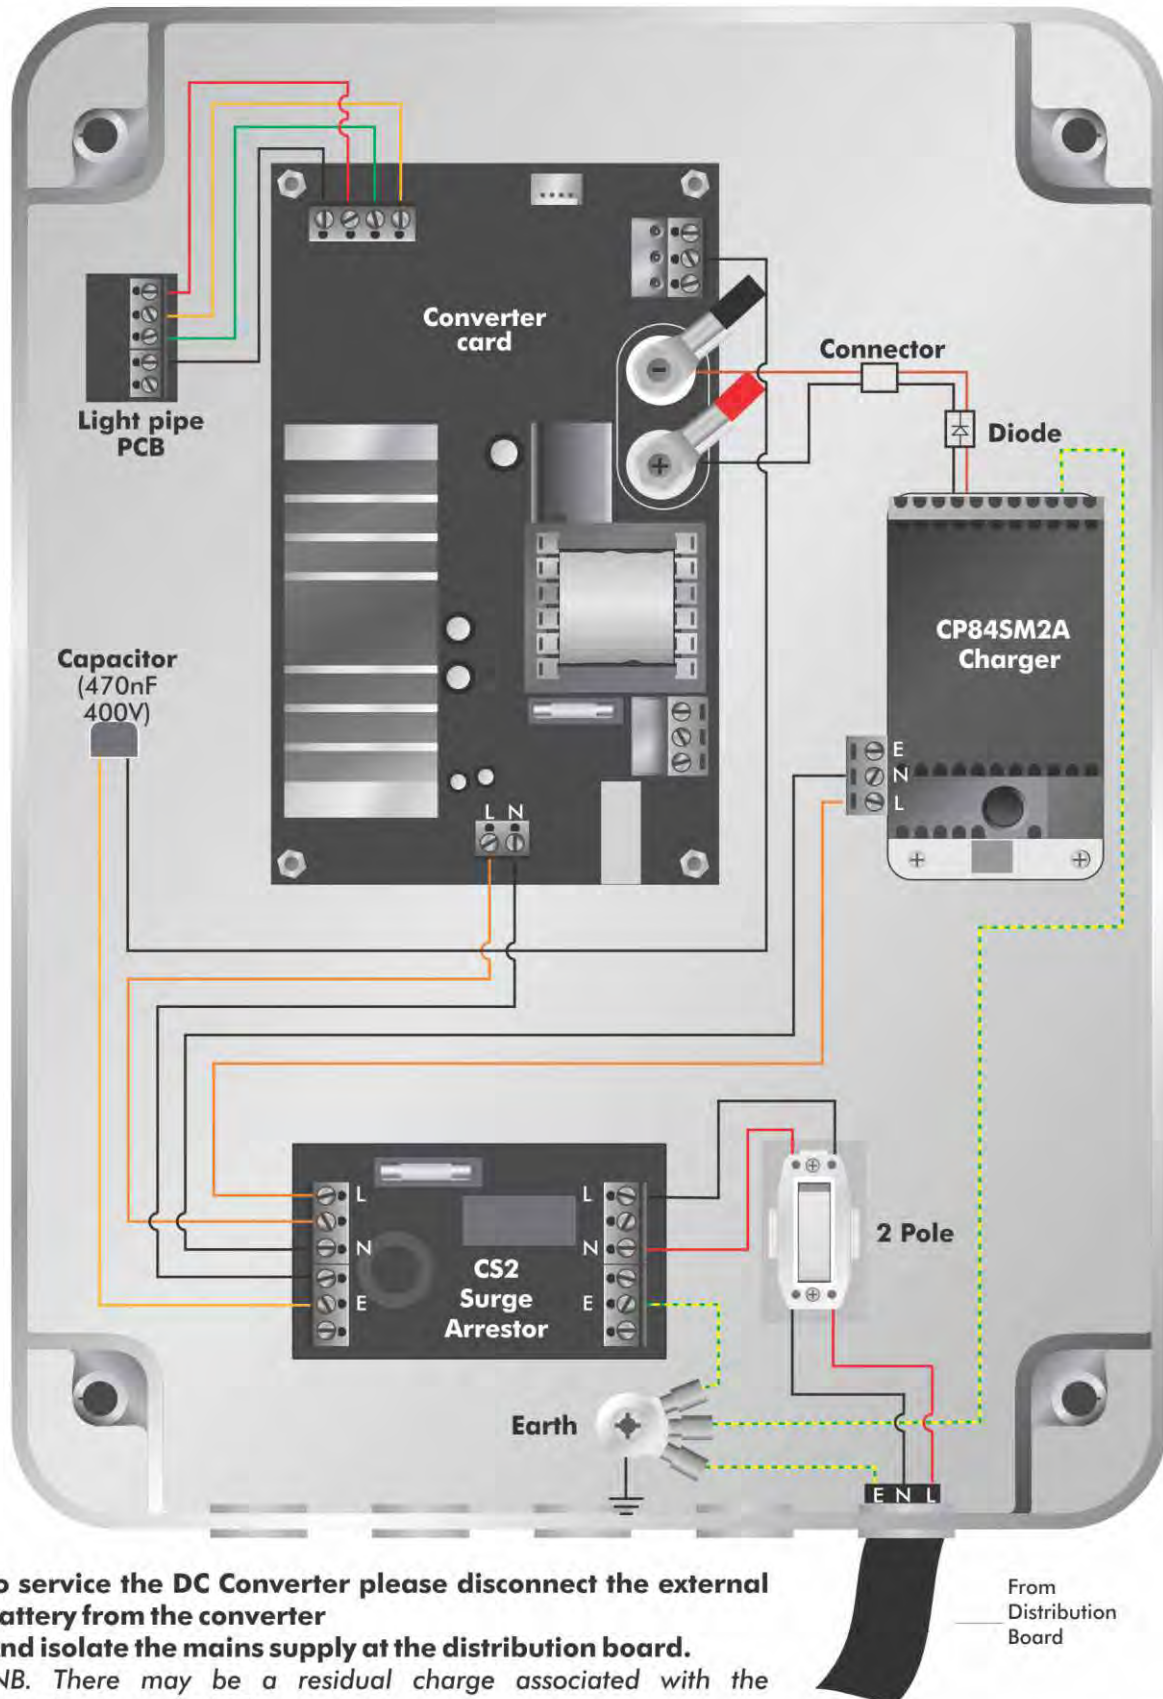

To service the DC Converter please disconnect the external battery from the converter
And isolate the mains supply at the distribution board.
(NB. There may be a residual charge associated with the capacitance on the A10 operator.
To ensure safety wait for the residual charge on the A10 operator to decay to safe levels.)

